


T-RATINGS FOR CAST IRON STACKS

POURED CONCRETE ON WOOD FORM
FOR REQUIRED T. RATING FOR FLOORS OR WALLS

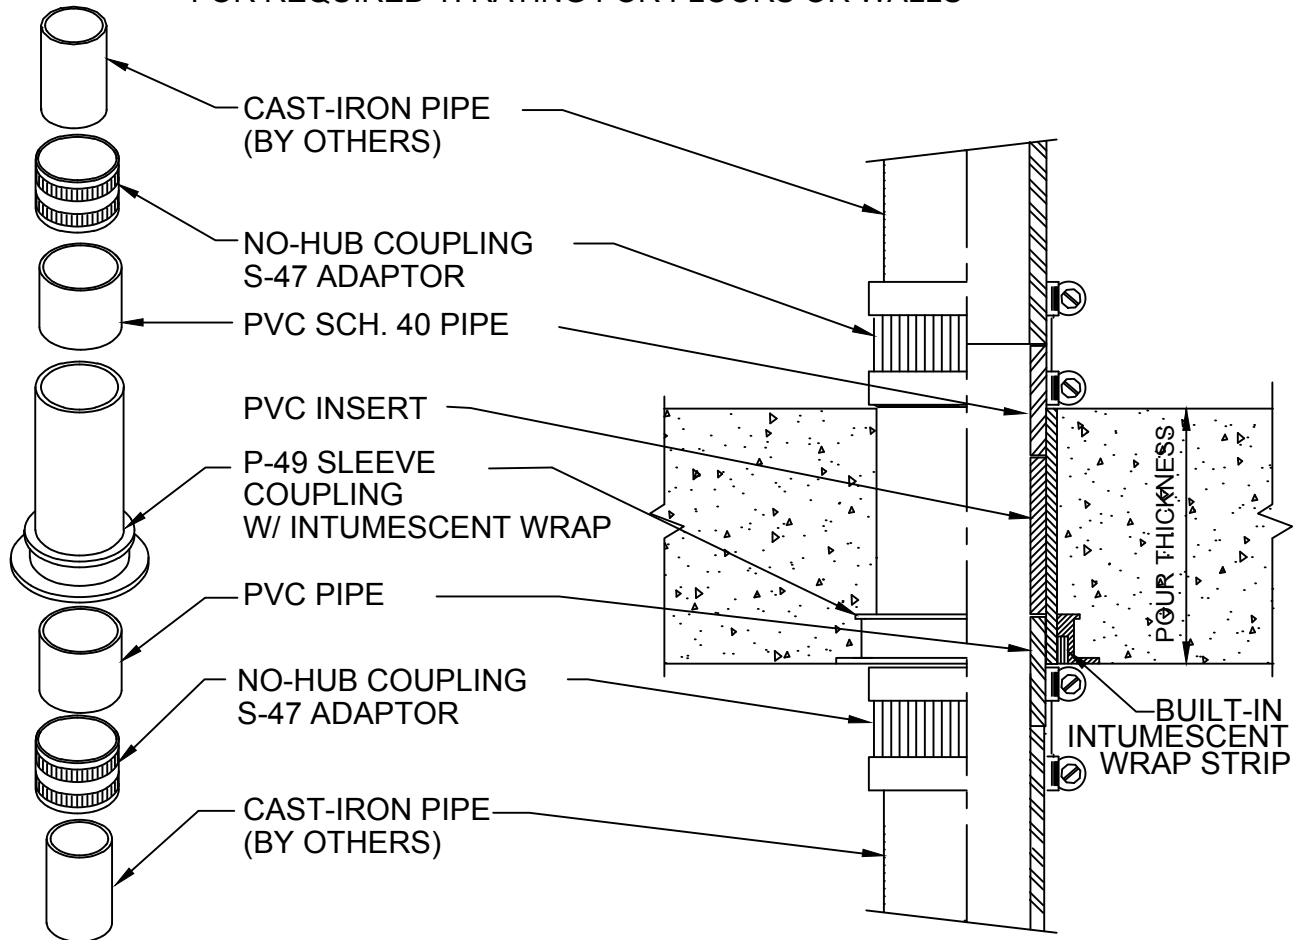

Size	Part No.	Description	Price	Unit Total
2"	P2548H-SSW	2" Self Seal Stack Stub-in	14.85	
2"	S25470 (2)	2" E-Z No-Hub Coupling	7.00	22.85
3"	P3548H-SSW	3" Self Seal Stack Stub-in	29.15	
3"	S35470 (2)	3" E-Z No-Hub Coupling	12.30	41.45
4"	P4548H-SSW	4" Self Seal Stack Stub-in	34.10	
4"	S45470 (2)	4" E-Z No-Hub Coupling	16.40	50.50

Note: This optional stack assembly is intended to provide the required T-Ratings when the stack is outside of the wall cavity.

W.H. Directory Reference 00 Edition
Firestop Device
W.H. Design No. PS/PHV 180-04
F Rating 3 Hrs. - T-Rating 3 Hrs..



PROSET[®]
SYSTEMS
FIRESTOP PENETRATOR™

DATE :
08-01-18
DRG . NO .
B-4807-A/B