


T-RATINGS FOR CAST IRON STACKS

PRECAST OR EXISTING CONCRETE
FOR REQUIRED T. RATING FOR FLOORS OR WALLS

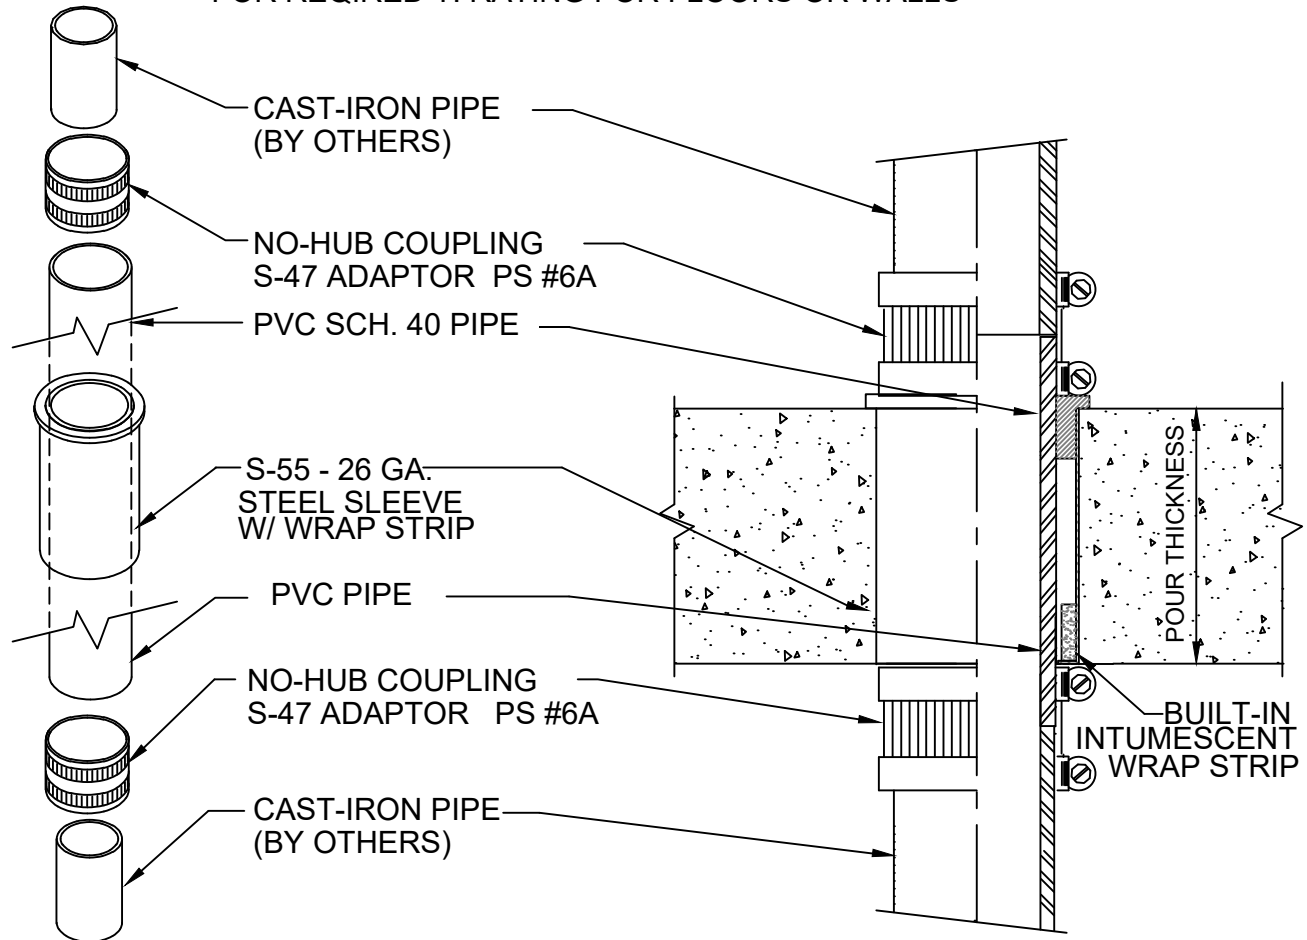

Size	Part No.	Description	Price	Unit Total	Core Size
2"	P25494 1/2-CH	2" Self Seal Sleeve	13.35		
2"	S25470 (2)	2" E-Z No-Hub Coupling	7.70	21.05	3"
3"	P35494 1/2-CH	3" Self Seal Sleeve	26.65		
3"	S35470 (2)	3" E-Z No-Hub Coupling	13.60	40.25	4 1/2"
4"	P45494 1/2-CH	4" Self Seal Sleeve	36.30		
4"	S45470 (2)	4" E-Z No-Hub Coupling	18.10	54.70	6"

Note: Units have a 4 1/2", 8" and 10" metal extensions below the Seal Ring coupling.
When ordering, insert the desired length instead of H. (ie) P254910-G-CH = 10" long sleeve.
Add \$ 2.45 more to the above prices if the extensions are 8" or 10".



W.H. Directory Reference 00 Edition
Firestop Device
W.H. Design No. PS/PHV 180-03
F Rating 3 Hrs. - T Rating 3 Hrs.



PROSET[®]
SYSTEMS
FIRESTOP PENETRATOR™

DATE :
05-30-21
DRG . NO .
B-4807-D