


LAV/SINK DROP LEG SLEEVE ASSEMBLY

FOR BOTH CORED HOLE & CAST-IN PLACE
PASSING THROUGH CONCRETE FLOORS

**NON-VENTED CLOSED END PENETRATIONS
DO NOT REQUIRE FIRE WRAP**

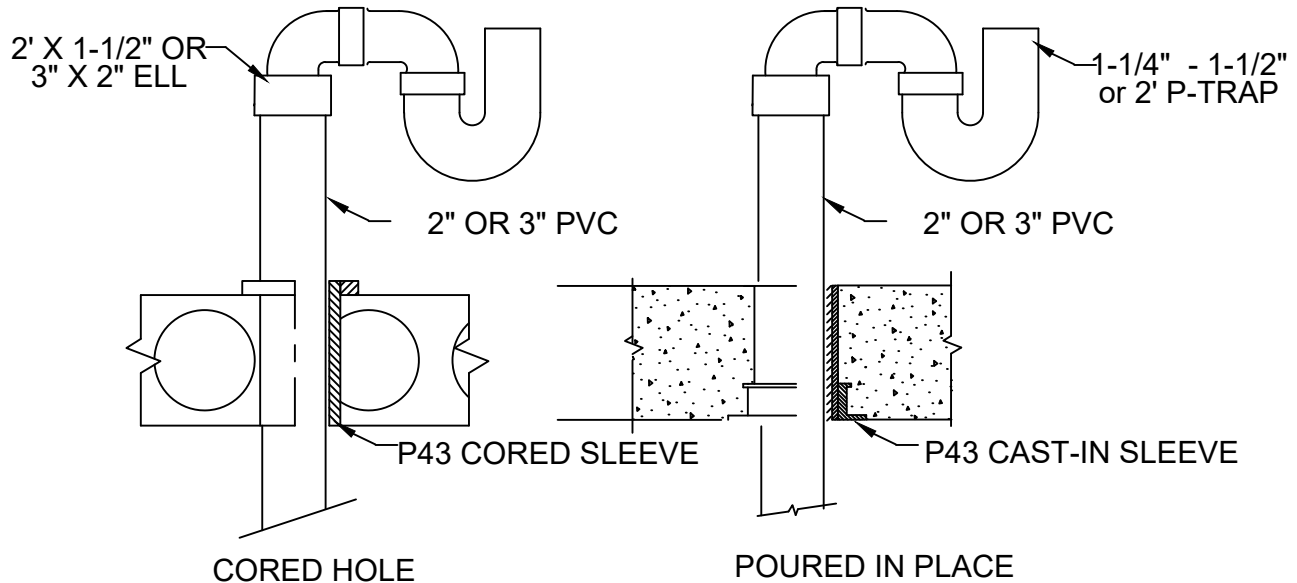

Size	Part No.	Description	Price	Hole Size
<u>FOR CORED HOLE SLEEVES</u>				
2"	P2543H-G-CH	2" Cored Coupling	4.95	2-3/4" or 3"
3"	P3543H-G-CH	3" Cored Coupling	7.40	4"
<u>FOR CAST-IN PLACE SLEEVES</u>				
2"	P2543H-G	2" Sleeve Coupling	7.15	
3"	P3543H-G	3" Sleeve Coupling	10.05	

NOTE: When ordering replace the letter "H" with the depth of the concrete.
P25436-G-CH would be for a cored hole sleeve and the concrete is 6" deep.
P25438-G would be for a cast-in place sleeve and the concrete is 8" deep.



W.H. Directory Reference 05 Edition
Firestop Device
W.H. Design No. PS/PH 120-08



PROSET[®]
SYSTEMS
FIRESTOP PENETRATOR™

DATE :
5-31-21
DRG . NO .
C-8130-ADp