


MASONRY WALL PENETRATION

FOR 1/2" THROUGH 1 1/2" PIPE
FOR BLOCK/BRICK WALLS



| Pipe | Size | Part No. | Description | Price | Unit Total |
|---------|--------|------------|------------------------|-------|------------|
| EMT/PVC | 1/2" | P2543H-MW | Sleeve Coupling | 4.55 | 9.85 |
| | | C20012 (2) | 2"x1/2" ProSeal Plug | 5.30 | |
| EMT/PVC | 3/4" | P2543H-MW | Sleeve Coupling | 4.55 | 9.85 |
| | | C20034 (2) | 2"x3/4" ProSeal Plug | 5.30 | |
| EMT/PVC | 1" | P2543H-MW | Sleeve Coupling | 4.55 | 9.85 |
| | | C20100 (2) | 2"x1" ProSeal Plug | 5.30 | |
| EMT/PVC | 1 1/4" | P2543H-MW | Sleeve Coupling | 4.55 | 9.85 |
| | | C20114 (2) | 2"x1 1/4" ProSeal Plug | 5.30 | |
| EMT/PVC | 1 1/2" | P2543H-MW | Sleeve Coupling | 4.55 | 9.85 |
| | | C20112 (2) | 2"x1 1/2" ProSeal Plug | 5.30 | |

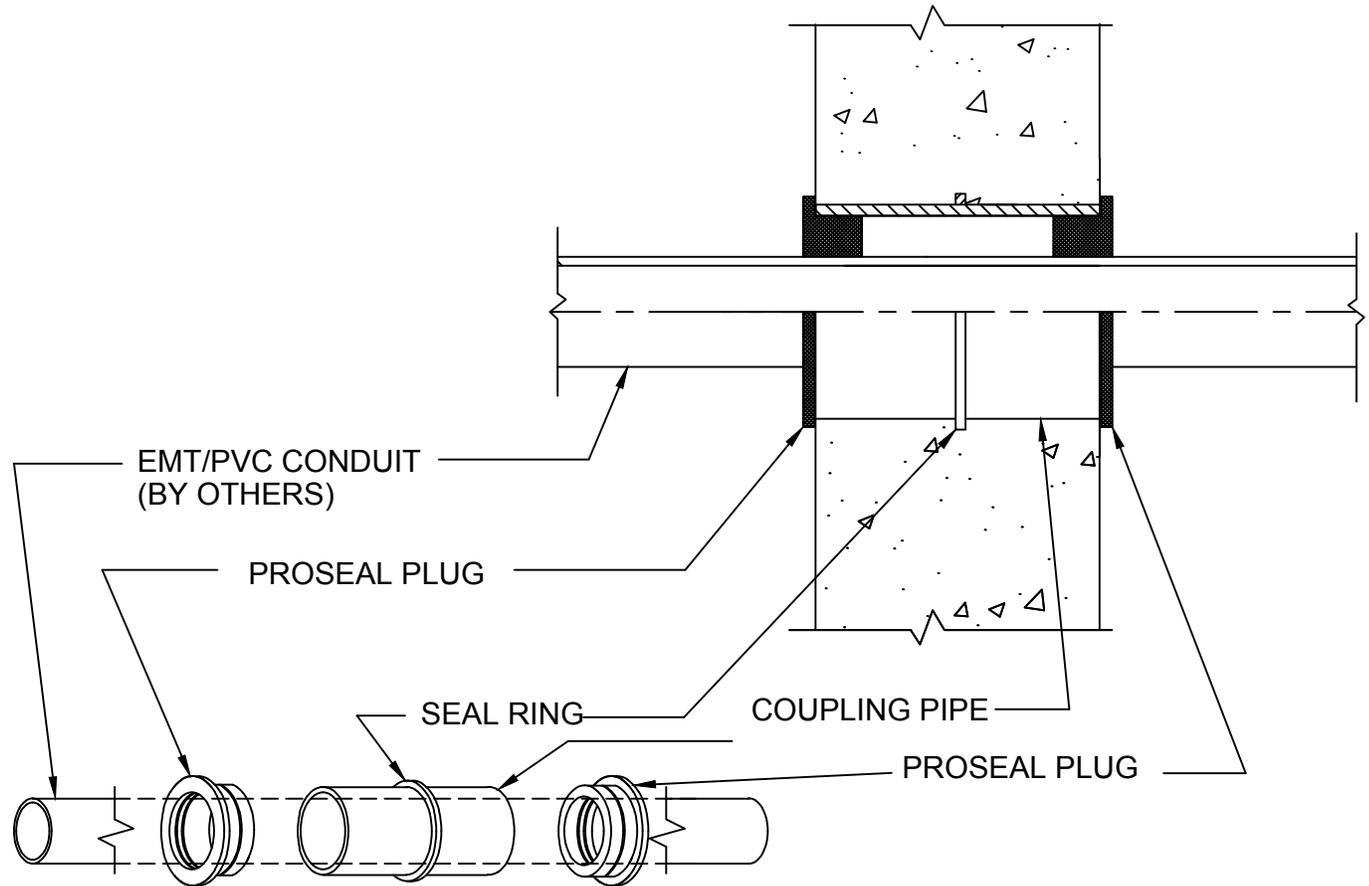

W.H. Directory Reference 97 Edition
Firestop Device
W.H. Design No. PS/PHV 120-04
F Rating 2 Hrs.



PROSET[®]
SYSTEMS
FIRESTOP PENETRATOR™

DATE :
12-11-19
DRG. NO.
E-1011-G