


LAV/SINK DROP LEG SLEEVE ASSEMBLY

FOR BOTH CORRUGATED METAL DECK THROUGH CONCRETE FLOORS

NON-VENTED CLOSED END PENETRATIONS
DO NOT REQUIRE FIRE WRAP

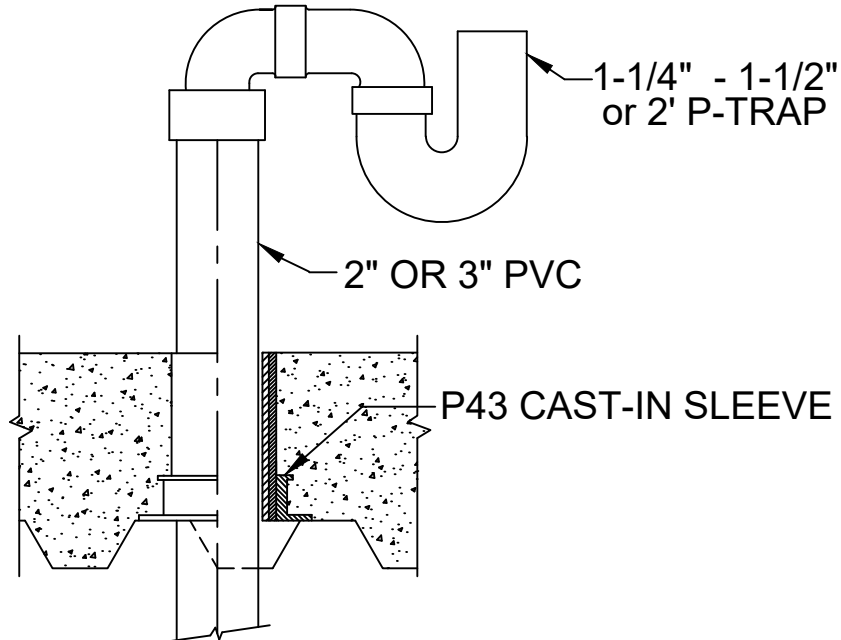

POURED IN PLACE

FOR CAST-IN PLACE SLEEVES

2"	P2543H-G	2" Sleeve Coupling	7.15
3"	P3543H-G	3" Sleeve Coupling	10.05

NOTE: When ordering replace the letter "H" with the depth of the concrete.
P25438-G would be for a cast-in place sleeve and the concrete is 8" deep.



W.H. Directory Reference 05 Edition
Firestop Device
W.H. Design No. PS/PH 120-08



PROSET[®]
SYSTEMS
FIRESTOP PENETRATOR™

DATE :
05-31-2021
DRG . NO .
C-8130-C