

FIRESTOP SYSTEMS


ProSet Systems, Inc.
1355 Capital Circle Lawrenceville, GA 30043-5866 U.S.A.

Design No. PS/PH 120-10

Horizontal (Floor)

Ratings: ASTM E-814 - 2 Hrs. (F), 2 Hrs. (T)

Test Pressure Differential - 2.5 Pa (0.0.1 In. of Water) minimum

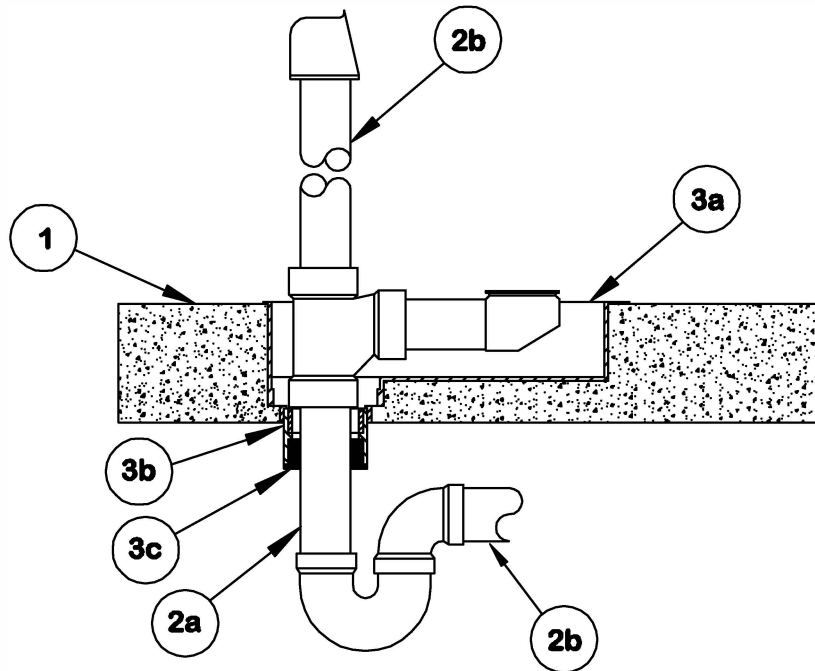

1. Floor: Minimum 3" thick normal density concrete slab.

2. Pipe Materials & Pipe Support:

2a. ProSet 1-1/2" P-90 F.R. PVC Pipe

2b. Sch. 40 ABS or cellular core PVC pipe.

P-Trap and branch piping to be reliably supported.

3. Firestop System Components:

3a. ProSet P25620S F.R. PVC Tub Box*

3b. ProSet 2" Coupling* extention solvent welded into tub box after the pour with one 1/8" X 3/4" factory built-in intumescent wrap strip on the top side of coupling.

3c. ProSet ProSeal Plug P-20112 or P-25661 inserted into bottom of coupling around the P-90 pass through pipe seal the opening.

*** Component Bearing the Warnock Hersey International Certification Mark.**