

# FIRESTOP SYSTEMS

## ProSet Systems, Inc.


1355 Capital Circle Lawrenceville, GA. 30043-5866 U.S.A.

### Design No. PS/PH 120-13

Horizontal (Floor) - See item 1.

Ratings: ASTM E-814 - 2 Hrs. & 3 Hrs. (F), 2 Hrs. (T) See item 1.

Test Pressure Differential - 2.5 Pa (0.01 in. of Water) Minimum

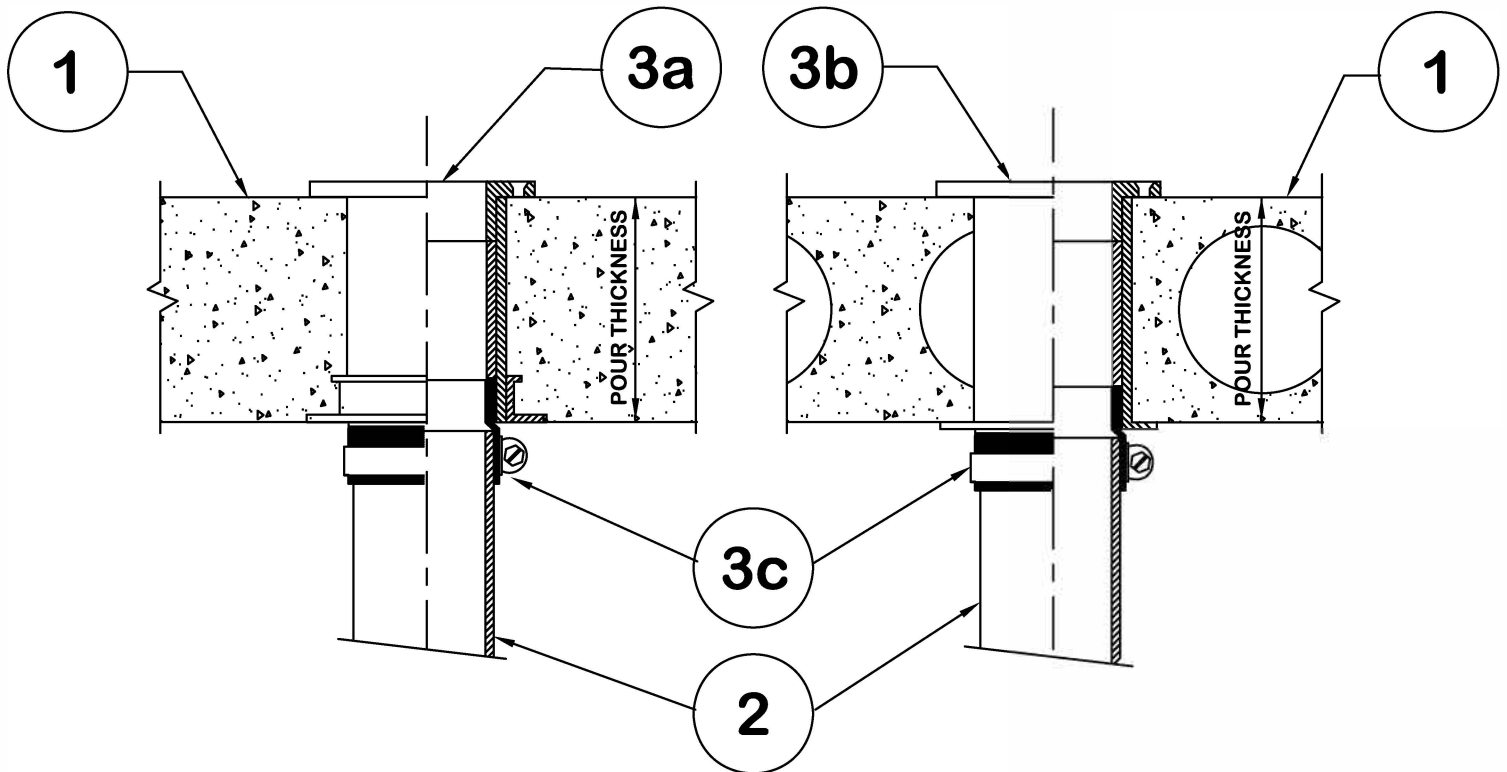

#### 1. Floor:

Minimum 4" thick normal density concrete slab or 7-1/2" thick hollowcore precast concrete floor units. Fluted decks with 2-1/2" concrete slab, rating is 1Hr F/FH.

When concrete or hollow core is 7 1/2" or more the FT/FTH rating is 3 Hrs.

#### 2. Pipe Material and Pipe Support:

3" or 4" Cast Iron or Copper DWV. - Closet or 1/4 bend can be supported by the firestop device.

#### 3. Firestop Device:

3a. Cast-in Part numbers P3544H-SX\*, 3" and P4544H-SX\*, 4".

3b. Inserted in cored hole -Part numbers P3543H-CH\*, 3" and P4543H-CH\*, 4".

3c. Adapter Flex Coupling -Part numbers P35470, 3" and P45470, 4".

#### Water Closet (Not Shown)

Floor mounted closet mount to closet flange.

**\* Components Bearing the Warnock Hersey International Certification Mark.**