

# FIRESTOP SYSTEMS

## ProSet Systems, Inc.

1355 Capital Circle Lawrenceville, GA 30043-5866 U.S.A.


### Design No. PS/PV 120-08

Vertical (wall)

Ratings: ASTM E-814 - 2 Hrs. (F), 1 Hrs. (T) See item 1.

CAN/ULC - S115- 2 Hrs. (F/FH) 1 Hrs. (FT/FTH)

Test Pressure Differential - 2.5 Pa (0.01 in. of Water) Minimum

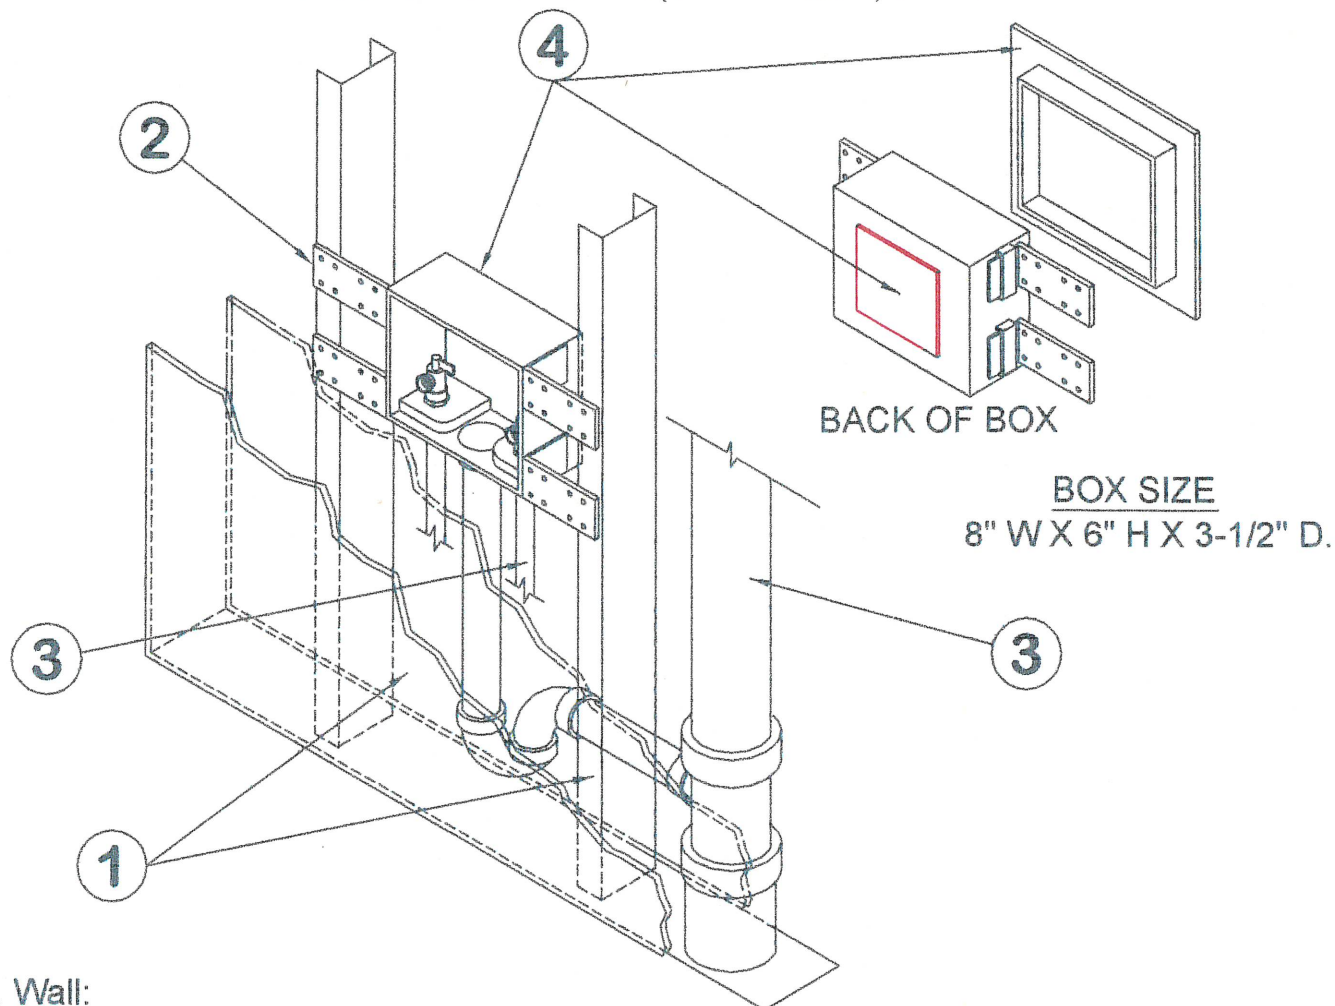

#### 1. Wall:

Gypsum board / steel or wood stud wall, with minimum 2-1/2" cavity width, having a one- or two-hour fire rating.

#### 2. Pipe Support:

Box and vertical pipe shall be supported by attaching the four box brackets in a secure manner to the wall studs. Branch and Stack piping to be rigidly supported within the cavity of the wall.

#### 3. Pipe Material:

Nominal 2" or larger Metallic, ABS or PVC DWV piping. Metallic or Plastic water supply piping.

#### 4. Firestop Device:

ProSet " Fire Guard Washer Box\* " made with a special fire rated resin with One 6" X 4" Red Intumescent adhesive pad mounted to the back of the box.

IMPORTANT: Washer Box units cannot be installed back to back within the same wall cavity. Gaps up to 1/2" around the box can be sealed with regular drywall cement. Gaps over 1/2" must be sealed with a silicone firestop sealant applied to the full depth of the membrane.

\* Component Bearing the Warnock Hersey International Certification Mark.